

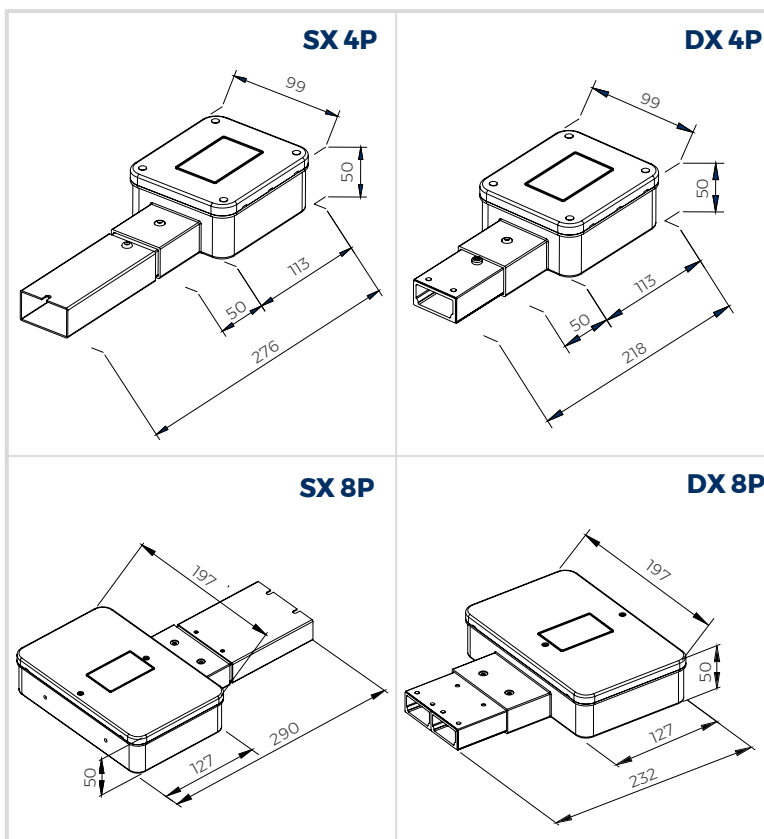
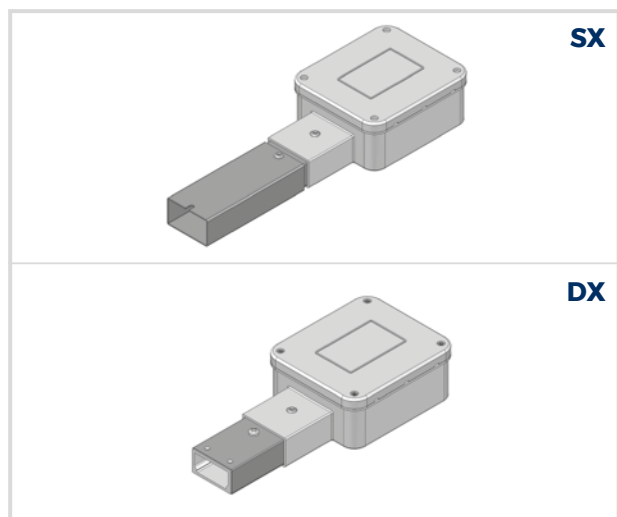


ALIMENTAZIONE DI TESTATA 25 / 40 A · FEED UNIT 25 / 40 A

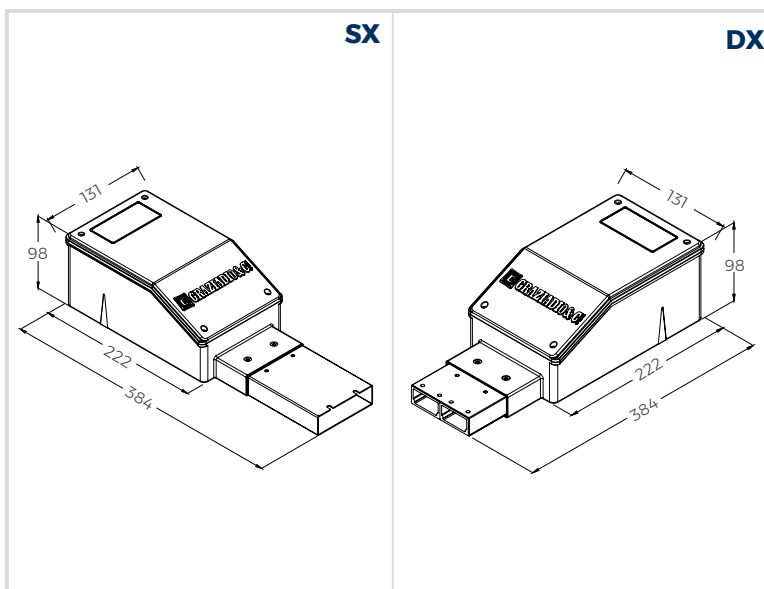


25 / 40 A		
	Codice/Code SX / LH	Codice/Code DX / RH
2/4P	GLSATS4	GLSATD4
Foro passaggio cavi Cables entrance	ø 30mm	ø 30mm
Sezione massima cavo Max cable cross section	16 mm ²	16 mm ²
Peso / Weight	0,31 kg	0,25 kg
2+2/6/8P	GLSATS8	GLSATD8
Foro passaggio cavi Cables entrance	ø 30x2 mm	ø 30x2 mm
Peso/Weight	0,65 kg	0,51 kg

ALIMENTAZIONE DI TESTATA 63 A · FEED UNIT 63 A

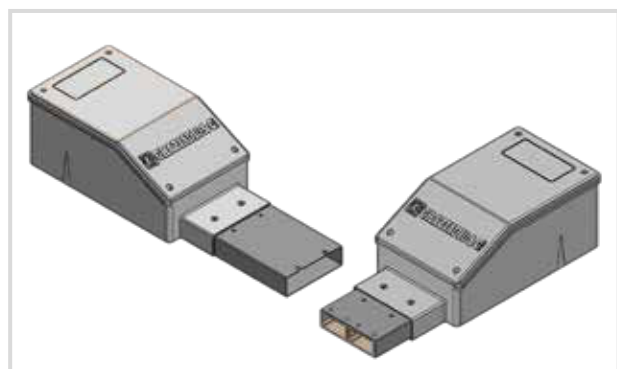

63 A		
	Codice/Code SX / LH	Codice/Code DX / RH
4P	GLSATS63	GLSATD63
Foro passaggio cavi Cables entrance	ø 55 mm	ø 55 mm
Sezione massima cavo Max cable cross section	35 mm ²	35 mm ²
Peso / Weight	0,75 kg	0,65 kg

CHIUSURA DI TESTATA · END CAP

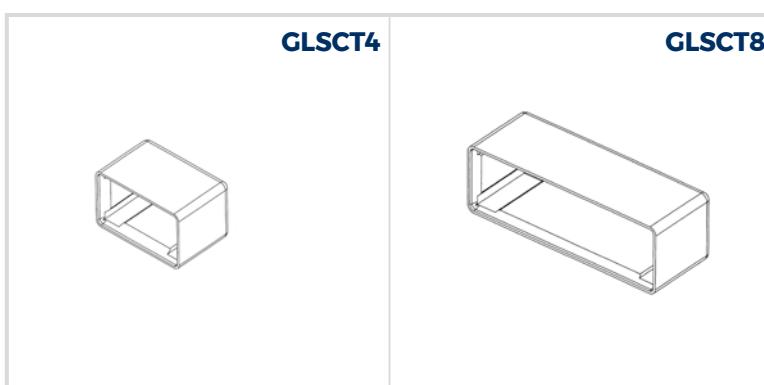

		Codice/Code	kg
25/40 A	2P	GLSCT4	0,02
	4P		
	2+2P 6P 8P	GLSCT8	0,03
63 A	4P	GLSCT8	0,03

